

NOTES

All dimensions in millimetres.

Precast concrete slabs to comply with BS EN 1339:2003.

Slabs shall be 63mm thick and, except where cutting is necessary, of uniform size, 600mm x 450mm.


Item coverage to include for supply and laying 25mm compacted thickness of Class (iii) dry mix mortar bedding course.

Slabs shall be laid with a bond of 300mm. This may be varied where economical use dictates, but shall not be less than 150mm.


All joints shall not be less than 5mm nor more than 10mm width.

Joints shall be filled with a proprietary high-strength water-resistant mortar to BS 7533-12 either as a slurry, or gun-applied and key pointed and similarly coloured to match slabs.


Infill mortar around obstructions should not exceed 25mm in width and should be the full depth of the slab and similarly coloured.



DETAIL OF POINTING

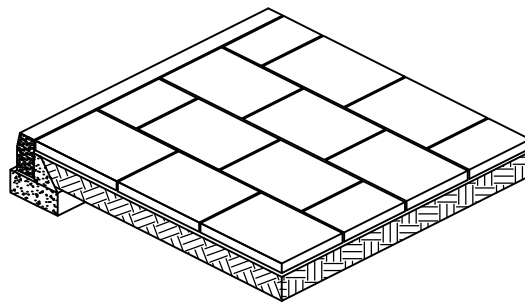

PAVING LAYOUT

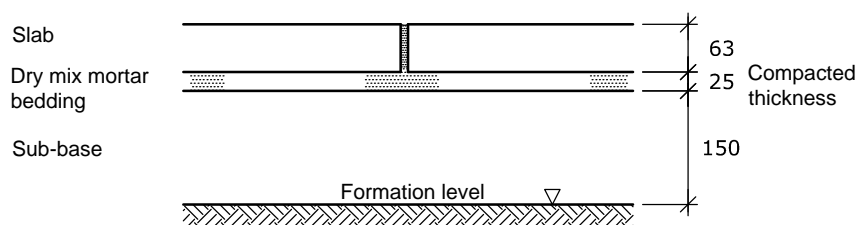

SECTIONAL ELEVATION